


# Cryogenic Gas Vent



**Gas Vents remove excess gas from the system to maintain liquid level and provide liquid on demand after a shut down period.**

- Gas Vents, when used, should be placed at the highest point in the system.
- An internal float is used to dispense the gas. Gas will be discharged until liquid is available to close the float.
- Bayonets are available on the outlet so that vacuum jacketed vent lines can carry the cryogenic gas to safety.
- A low pressure Safety Relief Valve (*1 psi for systems operating under 75 psi*) prevents moisture from coming back into the system.
- Vent heaters are also available to prevent the venting outlet from freezing.
- Available for all sizes of vacuum jacketed pipe that Technifab Products, Inc. offers.

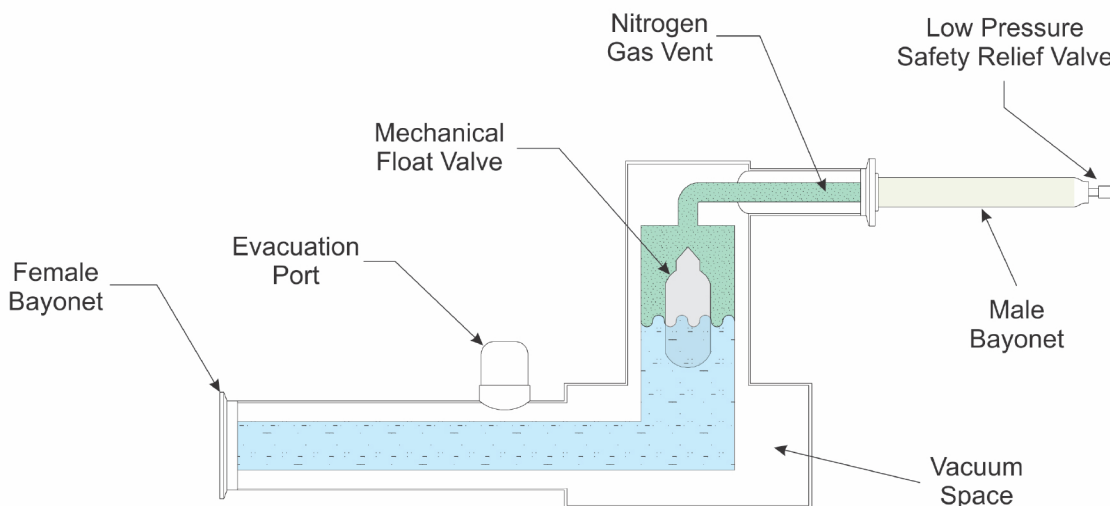